



Community Public Water Systems Status

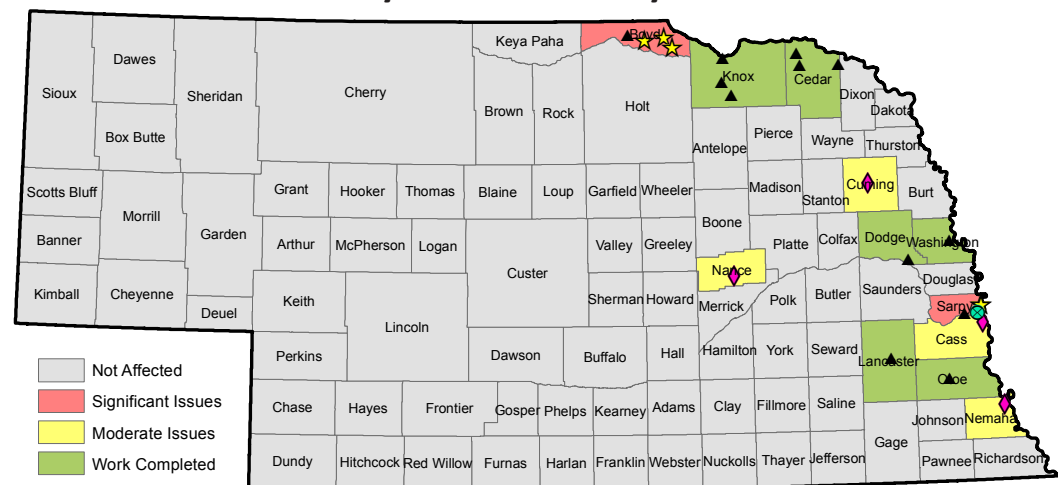


- ★ Repairs to PWS not Complete - Unable to provide consistent source of safe drinking water
- ◆ Repairs to PWS not Complete - Providing consistent source of safe drinking water
- ▲ Repairs Complete - PWS operating normally
- System Permanently Inactivated

Non-Community Public Water Systems Status

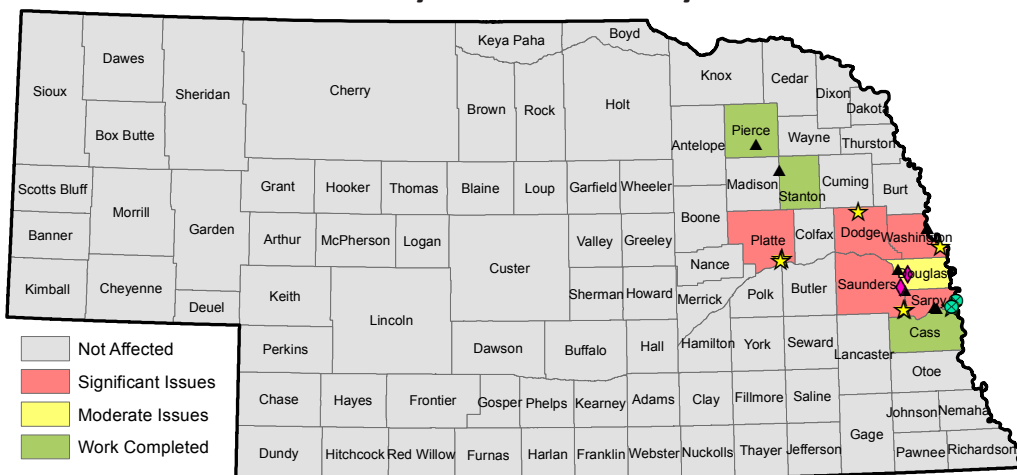


- ★ Repairs to PWS not complete - unable to provide consistent source of safe drinking water
- ◆ Repairs to PWS not complete - providing consistent source of safe drinking water
- ▲ Repairs complete - PWS operating normally
- System Permanently Inactivated

Wastewater Facility Status

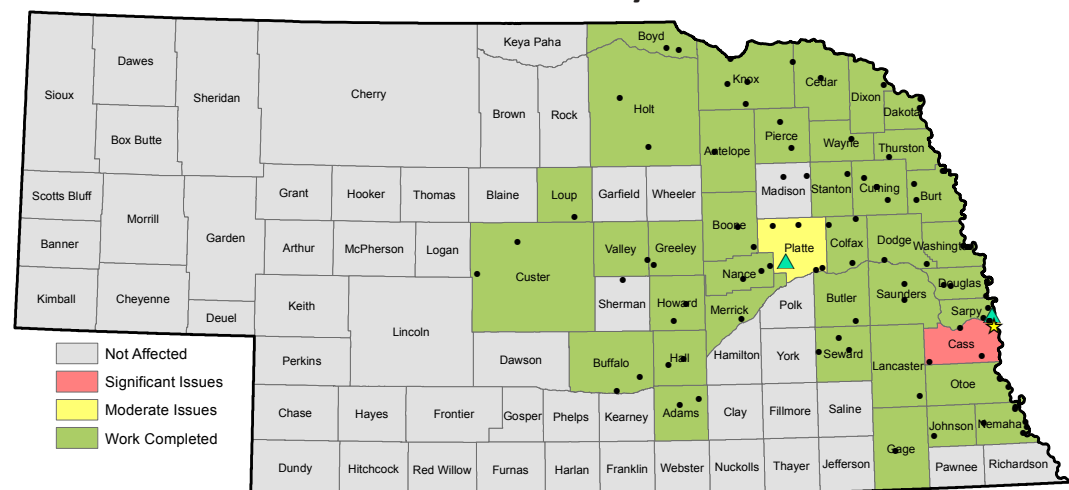


- ★ Discharging - No Treatment
- ▲ Primary Treatment Resumed - No Secondary Treatment
- Facility operating normally

Waste Debris Management Status

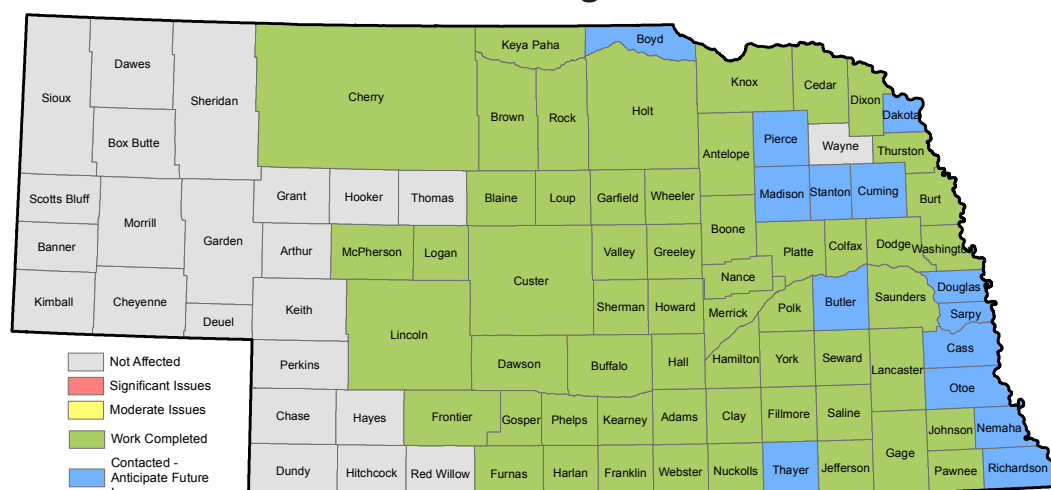

Livestock Facility Status

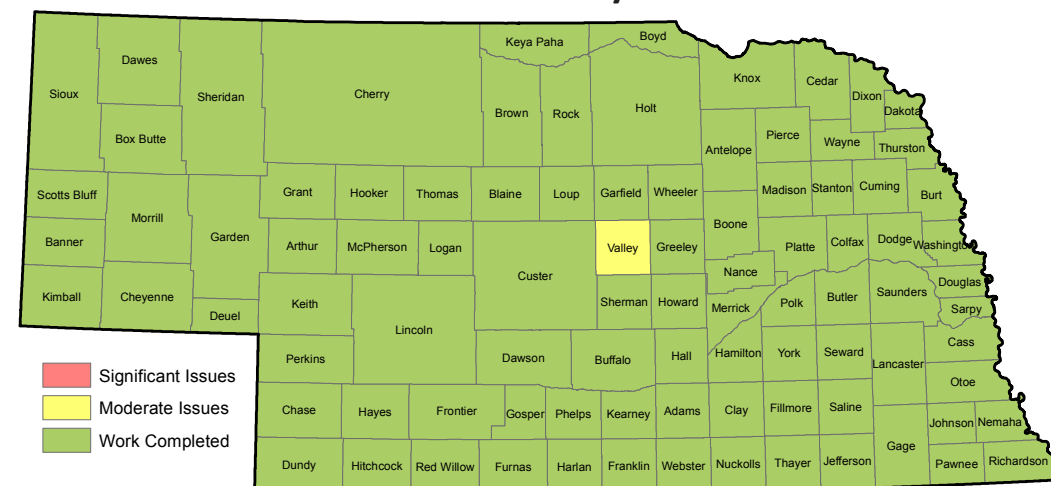

Branches	
Waste/debris	<p>Objectives:</p> <ul style="list-style-type: none"> Public guidance and outreach for debris management <p>Status:</p> <ul style="list-style-type: none"> Worked with the EPA on reporting and recovering containers of hazardous substances. This project has been completed. Continue providing guidance to affected counties as floodwater recedes
Wastewater	<p>Objectives:</p> <ul style="list-style-type: none"> Investigate discharges and evaluate structures for damage Work with a livestock waste control facility (LWCF) on creating a timeline for resuming normal operations. Work with waste water treatment facilities (WWTF) on timeline for restarting normal operations. Offer/provide financial assistance from the State Revolving Fund (SRF), if needed <p>Status:</p> <ul style="list-style-type: none"> Working with the Plattsouth WWTF and Crab Orchard's WWTF in their recovery efforts following the March flooding. NDEE made state revolving loan funds available to affected communities. These loans — with 0% interest and 0% administrative fees — will act as bridge financing until FEMA public assistance is available.
Drinking/public water	<p>Objectives:</p> <ul style="list-style-type: none"> Provide technical assistance to Public Water Systems (PWS) compromised by flooding Coordinate with PWS owners/operators to develop timelines for restoring service <p>Status:</p> <ul style="list-style-type: none"> Currently, four community PWS, and 9 non-community PWS with primary sources of water still off-line Made state revolving loan funds available to affected communities. These loans — with 0% interest and 0% administrative fees — will act as bridge financing until FEMA public assistance is available.
Air	<p>Objectives:</p> <ul style="list-style-type: none"> Coordinate with local emergency managers/fire departments for individual burn permits for flood-damage structures <p>Status:</p> <ul style="list-style-type: none"> Burn permits requested — 8 Burn permits issued — 8 Burn permits denied — 0 Assessed numerous impacted lake communities in Sarpy and Douglas counties Worked with a local fire chief to distribute burn summary information to rural fire departments in Washington, Douglas, Sarpy, Dodge and Saunders counties.
Energy	<p>Objective:</p> <ul style="list-style-type: none"> Administer weatherization and loan programs <p>Status:</p> <ul style="list-style-type: none"> Offered the Dollar and Energy Savings Loan at 1% interest for March flooding. As of Aug. 26: <ul style="list-style-type: none"> 124 loans committed for \$2,572,647.28 16 loans entered (not yet committed) for \$35,394.48 35 loans participated for \$427,599.46 Initiated the Weatherization Assistance Program for emergency repairs/replacement for HVAC systems. As of Aug. 26: <ul style="list-style-type: none"> Work completed in five homes Work in-progress in two homes Three pending applications \$17,527.76 in weatherization assistance. Offered the DESL at 1% interest for the July flooding in the Central Platte and Republican River Basin areas. As of Aug. 26: <ul style="list-style-type: none"> Two loans committed for \$19,842.27 Two loans entered (not yet committed) for \$20,558.87 Zero loans participated at \$0.

Legend

- = not affected
- = completed work
- = moderate issues
- = many/significant issues
- = anticipate future needs

Numbers in red boxes correspond with counties listed in the narrative below. The narrative explains why the county has a red designation.

Updates from Aug. 18 dashboard

- The Air Division Issued an eighth burn permit.
- Information on the Dollar and Energy Savings Loan and the Weatherization Assistance Program was updated on page 1.
- In drinking water, Boyd County Rural Water District #2 is making final preparations to install a new water line this week.
- Plattsmouth has completed repairs at its drinking water plant. Plant start up is tentatively set for Aug. 30, pending flushing and results from final coliform samples.
- Heron Bay's non-community public water system has been repaired and re-activated. It will remain on this week's narrative.

Red designations for drinking water

There are currently four community Public Water Systems (CWS) and 9 non-community public water systems (NCWS) with primary sources of water still off-line.

Community Public Water Systems (CWS)

Boyd County¹

• **Boyd County Rural Water Dist. #2:** The sole transmission line between the system's wells and the distribution system was washed-out by the Niobrara River. The initial bore for the new line was completed on July 23. Final preparations are in progress to begin installation of the new line within the week.

Three non-public water supply wells have been temporarily connected to the system to provide water. Samples collected from the system have shown low levels of nitrates and no presence of E. coli. The water is being disinfected and the system is being allowed to operate under a boil-water advisory.

• **Village of Lynch:** Purchases all water from Boyd County Rural Water Dist. #2 and is therefore subject to the same circumstances provided above.

• **Village of Spencer:** Purchases all water from Boyd County Rural Water Dist. #2 and is therefore subject to the same circumstances provided above.

Cass County

• **City of Plattsmouth:** The wells and treatment plant were flooded and have sustained significant damage from water and debris. The system is currently providing water by an emergency connection to Cass County Rural Water District #1. An additional connection to Beaver Lake public water system is also available. Repairs at the plant are complete, and new filter media has been installed. Pending flushing and results from final coliform samples from the filters, plant start-up is tentatively planned for Friday, Aug. 30.

Nemaha County

• **City of Peru:** The wells and treatment plant were flooded, and sustained significant damage from water and debris. Water is currently being trucked-in from the City of Auburn to fill Peru's water tower. Well repairs are complete. A temporary mobile treatment plant was brought in to provide water for the community. However, raw water quality was not compatible with the treatment processes. A new mobile plant with a compatible technology was placed into service on July 25. Water is no longer being trucked from Auburn, but trucks will remain on stand-by. Testing throughout the system indicates no presence of coliform bacteria. The department was notified Aug. 12 that the boil-water advisory has been

lifted. Modifications continue to be made to fine-tune the treatment process.

Sarpy County³

• **Paradise Lakes:** This is a consecutive system to Metropolitan Utilities District. The system is still pressurized, but has been temporarily inactivated because all homes (mobile homes) were deemed "Inhabitable" by the City of Bellevue.

Non-Community Public Water Systems (NCWS)

Douglas County

• **Riverwest Park:** The system was flooded. North Beach well and distribution system are operational, and Riverwest Park is Partially open for business. Its designation has changed to yellow.

Platte County²

• **Loup River Public Power District:** The Headworks Park well flooded and the system has been temporarily inactivated. No timeline for repairs.

• **T-Bone Truck Stop:** The water system is heavily damaged. The system has been temporarily inactivated. The timeline for repairs is estimated to be around two to three months.

Sarpy County³

• **Coreslab Structures:** The well is operational, but a portion of the distribution system is damaged. Repairs to potable portion of system will not be complete for two to three months. The system has been temporarily inactivated.

• **Falconwood Park:** The system was flooded and the well is likely compromised. Repairs are underway, but the park will remain closed for foreseeable future. The system has been temporarily inactivated.

• **Heron Bay:** The system was flooded. Repairs to the water system are complete and the system has been re-activated.

Saunders County⁴

• **Military Dept. of Nebraska-Camp Ashland:** The water system was under water and was compromised. Repairs to the water system are underway, but there is no timetable provided on completion.

Washington County⁵

• **Desoto Park Estates:** The system flooded and is possibly compromised. There is currently no access or power to system. System temporarily inactivated.

COUNTY	Drinking Water	Wastewater	Debris Management	Livestock
Adams				
Antelope				
Arthur				
Banner				
Blaine				
Boone				
Box Butte				
Boyd	1			
Brown				
Buffalo				
Burt				
Butler				
Cass		6		
Cedar				
Chase				
Cherry				
Cheyenne				
Clay				
Colfax				
Cuming				
Custer				
Dakota				
Dawes				
Dawson				
Deuel				
Dixon				
Dodge				
Douglas				
Dundy				
Fillmore				
Franklin				
Frontier				
Furnas				
Gage				
Garden				
Garfield				
Gosper				
Grant				
Greeley				
Hall				
Hamilton				
Harlan				
Hayes				
Hitchcock				
Holt				
Hooker				
Howard				
Jefferson				
Johnson				
Kearney				
Keith				
Keya Paha				
Kimball				
Knox				
Lancaster				
Lincoln				
Logan				
Loup				
Mc Pherson				
Madison				
Merrick				
Morrill				
Nance				
Nemaha				
Nuckolls				
Otoe				
Pawnee				
Perkins				
Phelps				
Pierce				
Platte	2			
Polk				
Red Willow				
Richardson				
Rock				
Saline				
Sarpy	3			
Saunders	4			
Scotts Bluff				
Seward				
Sheridan				
Sherman				
Sioux				
Stanton				
Thayer				
Thomas				
Thurston				
Valley				
Washington	5			
Wayne				
Webster				
Wheeler				
York				

Information for wastewater

- **Cass County⁶**—Plattsmouth WWTF is re-installing electrical equipment, but is not yet treating water as of June 25.
- **Johnson County**—Crab Orchard WWTF's stream bank/outer lagoon dike has not been repaired, however, its lift stations and pumps are operational, with lagoons providing treatment. It has a yellow designation.

Information for debris management

NDEQ team members met with emergency managers in 70 counties to provide assistance for debris management. After these meetings, counties were upgraded to green designations, or marked as blue, indicating that they might need further assistance as floodwaters recede.

Information for livestock

A livestock operation in Valley County needs repairs, but is fixed enough that they are no longer actively discharging. The livestock operation in Howard County has been completely repaired and upgraded to a green designation.