
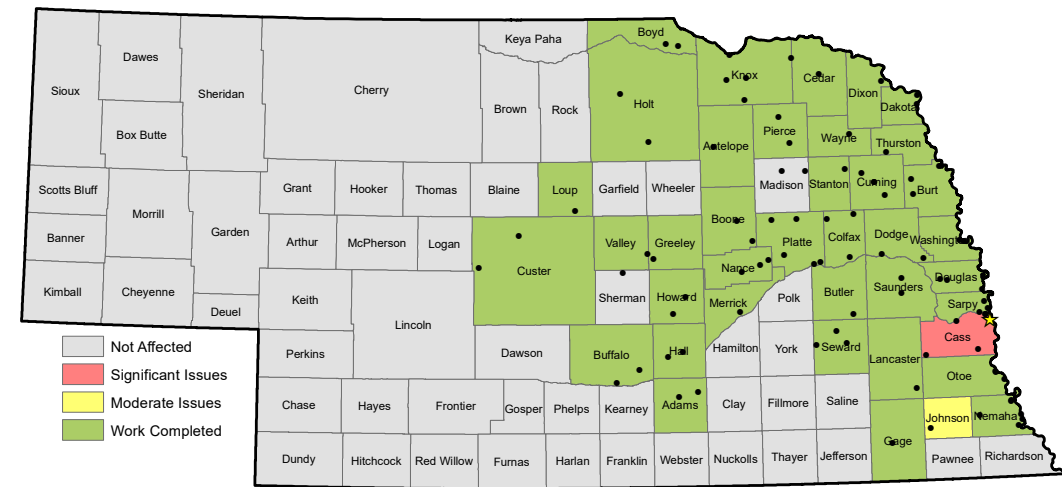
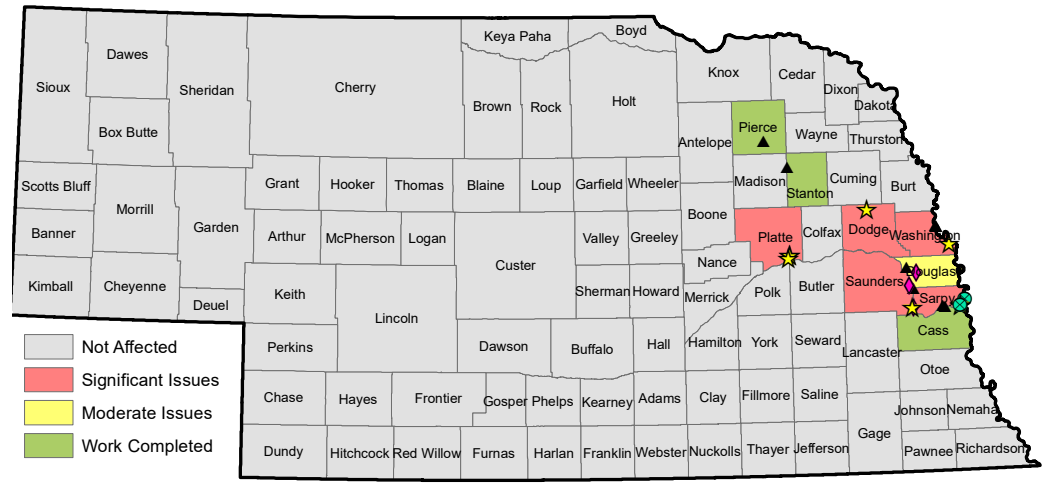


Community Public Water Systems Status

Non-Community Public Water Systems Status

Wastewater Facility Status

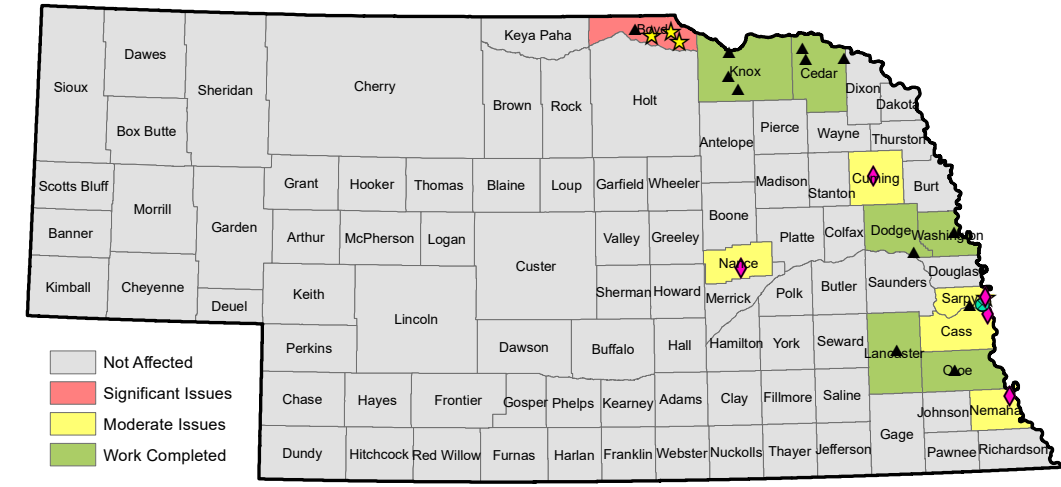



- ★ Repairs to PWS not Complete - Unable to provide consistent source of safe drinking water
- ◆ Repairs to PWS not Complete - Providing consistent source of safe drinking water
- ▲ Repairs Complete - PWS operating normally
- System Permanently Inactivated

- ★ Repairs to PWS not complete - unable to provide consistent source of safe drinking water
- ◆ Repairs to PWS not complete - providing consistent source of safe drinking water
- ▲ Repairs complete - PWS operating normally
- System Permanently Inactivated

- ★ Discharging - No Treatment
- ▲ Primary Treatment Resumed - No Secondary Treatment
- Facility operating normally

Livestock Facility Status

Waste Debris Management Status

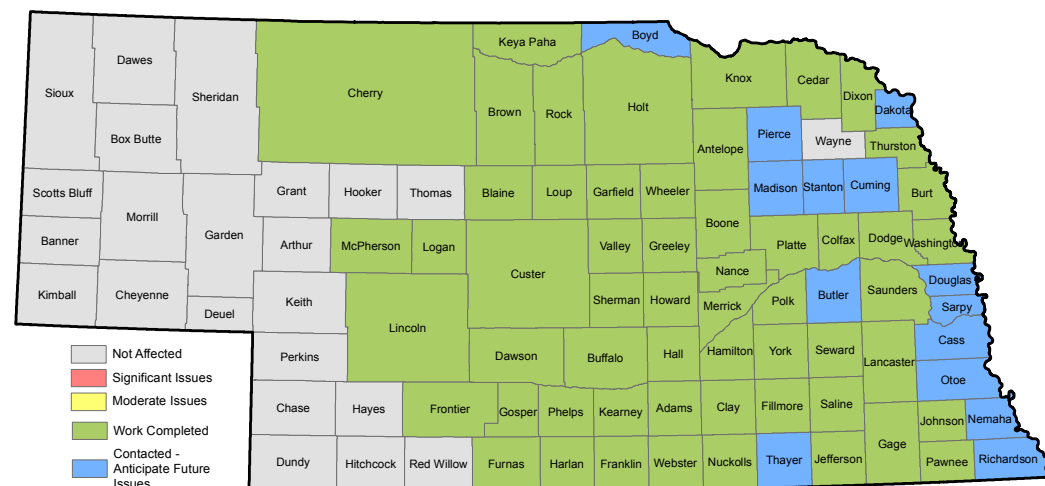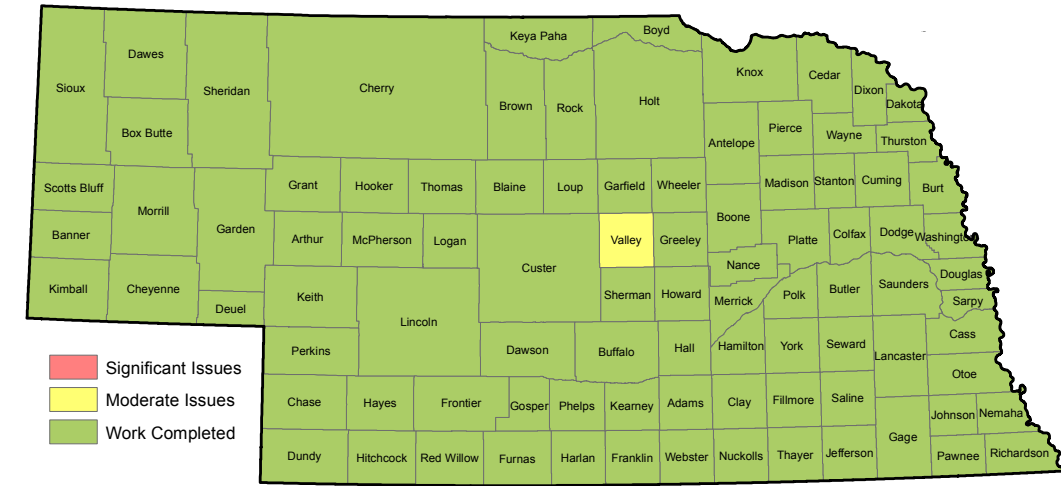

- Significant Issues
- Moderate Issues
- Work Completed

- Not Affected
- Significant Issues
- Moderate Issues
- Work Completed
- Contacted - Anticipate Future Issues

Legend

- grey = not affected
- red = many/significant issues
- green = completed work
- yellow = moderate issues
- blue = anticipate future needs

Update from Sept. 1

• Boyd County Rural Water District #2 has a new transmission line installed with final connections being made. This week, the line will be flushed, pressure tested and collections of coliform samples will be taken. Once the line is in service and the system stabilized, the coliform samples from all three systems must be collected before removing the boil water advisory.

COUNTY	Drinking Water	Wastewater	Debris Management	Livestock
Boyd	New transmission line installed and final connections made. Flushing, pressure testing and testing for coliform need to take place before boil water advisory is lifted.			
Butler				
Cass		Plattsmouth WWTF is re-installing electrical equipment and not yet treating		
Cuming				
Dakota				
Douglas				
Johnson				
Madison				
Nance				
Nemaha				
Otoe				
Pierce				
Platte	NCWSs in Loup River Public Power District and the T-Bone Truck Stop are temporarily inactivated			
Richardson				
Sarpy	NCWSs in Corelab Structures and Falcolnwood Park are temporarily inactivated			
Saunders	The Military Dept. of Nebraska-Camp Ashland is working to repair its system			
Stanton				
Thayer				
Valley				
Washington	Desoto Park Estates NCWS has been temporarily inactivated			

Branches

Drinking/public water	Wastewater	Energy
<p>Objectives:</p> <ul style="list-style-type: none"> Provide technical assistance to Public Water Systems (PWS) compromised by flooding Coordinate with PWS owners/operators to develop timelines for restoring service <p>Status:</p> <ul style="list-style-type: none"> Currently, three community PWS, and seven non-community PWS with primary sources of water still off-line Made state revolving loan funds available to affected communities. 	<p>Objectives:</p> <ul style="list-style-type: none"> Work with a livestock waste control facilities (LWCF) and wastewater treatment facilities <p>Status:</p> <ul style="list-style-type: none"> Working with the Plattsmouth WWTF and Crab Orchard's WWTF in their recovery efforts NDEE made state revolving loan funds available to affected communities. 	<p>Objective:</p> <ul style="list-style-type: none"> Administer weatherization and loan programs <p>Status:</p> <ul style="list-style-type: none"> Offered the Dollar and Energy Savings Loan at 1% interest for March flooding. As of Aug. 26: 124 loans committed for \$2,572,647.28 16 loans entered (not yet committed) for \$35,394.48 35 loans participated for \$427,599.46 Initiated the Weatherization Assistance Program for emergency repairs/replacement for HVAC systems. As of Aug. 26: Work completed in five homes Work in-progress in two homes Three pending applications \$17,527.76 in weatherization assistance. Offered the DESL at 1% interest for the July flooding in the Central Platte and Republican River Basin areas. As of Aug. 26: Two loans committed for \$19,842.27 Two loans entered (not yet committed) for \$20,558.87 Zero loans participated at \$0.
Air	Waste/debris	
<p>Objectives:</p> <ul style="list-style-type: none"> Coordinate with local emergency managers/fire departments for individual burn permits <p>Status:</p> <ul style="list-style-type: none"> Burn permits requested/ issued — 8/8 	<p>Objectives:</p> <ul style="list-style-type: none"> Public guidance and outreach for debris management <p>Status:</p> <ul style="list-style-type: none"> Continue providing guidance as floodwater recedes 	