
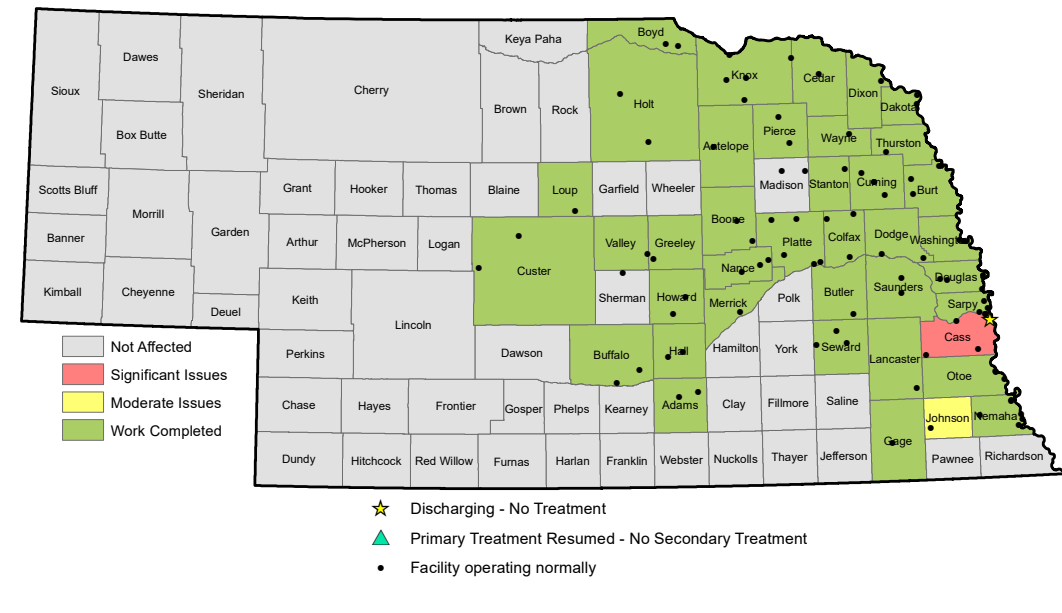
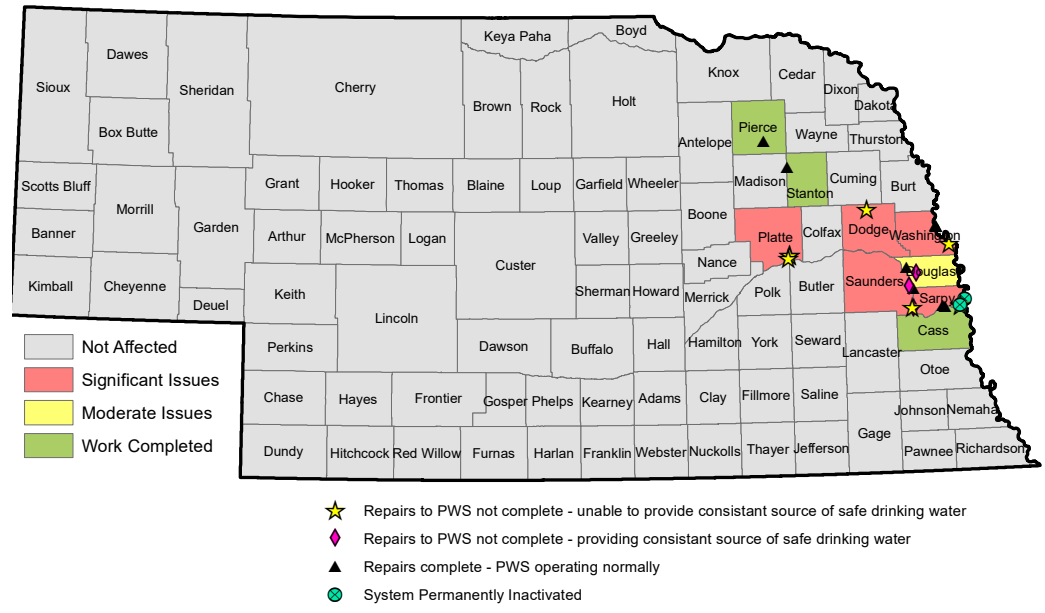


Community Public Water Systems Status

Non-Community Public Water Systems Status

Wastewater Facility Status


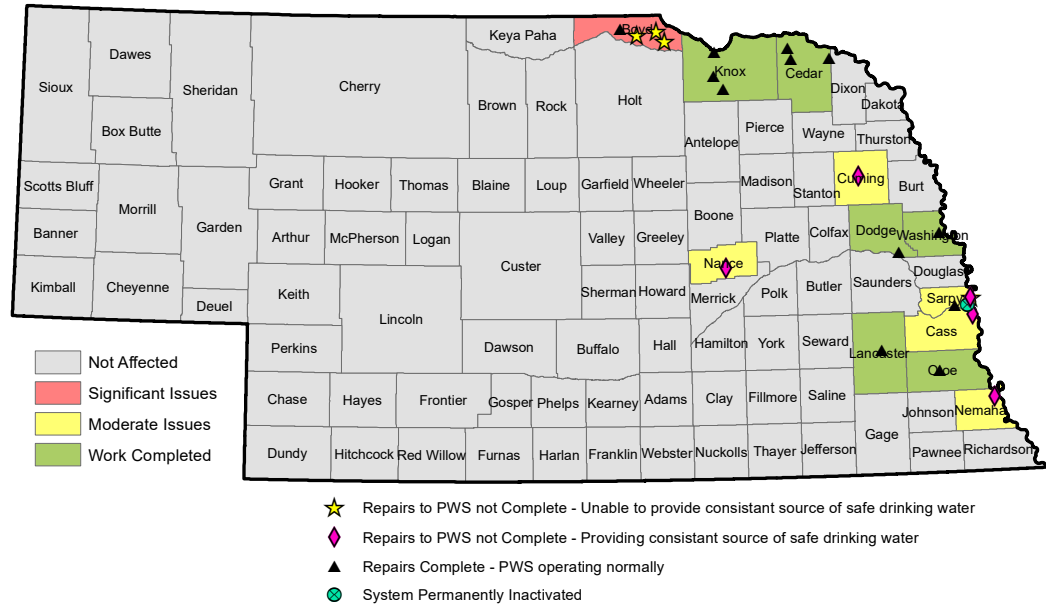


Livestock Facility Status

Waste Debris Management Status

Legend

Update from Sept. 8

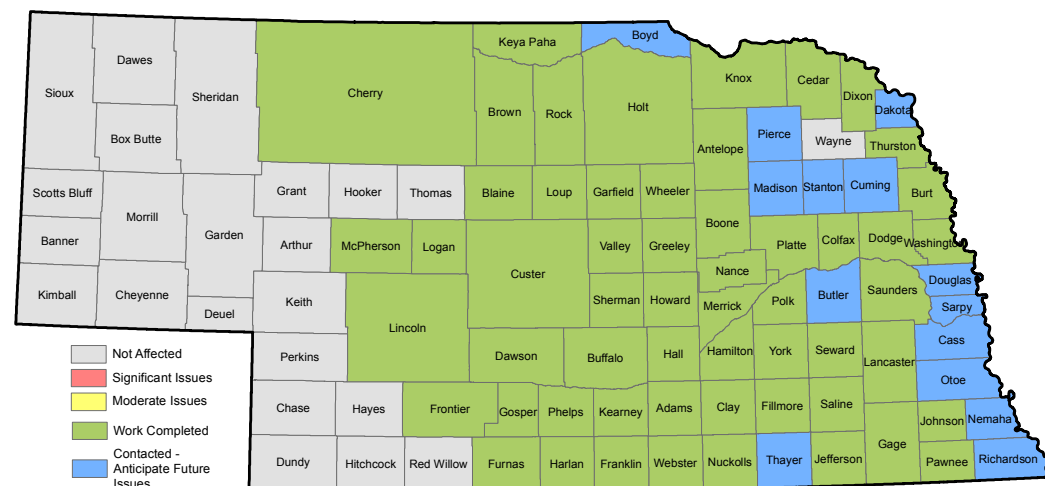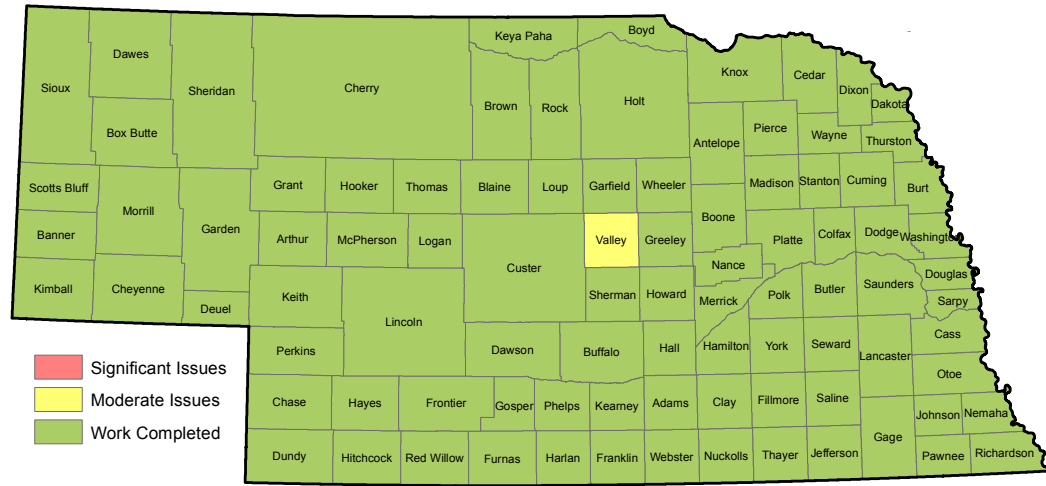

= not affected
 = completed work
 = moderate issues
 = many/significant issues
 = anticipate future needs

• Boyd County Rural Water District #2 has installed a new transmission line and it has been placed into service. Water samples from all three systems, which include a rural system and the villages of Lynch and Spencer, will be collected to confirm the absence of coliform bacteria before removing the boil-water advisory.

Branches	
Drinking/public water	Wastewater
<p>Objectives:</p> <ul style="list-style-type: none"> Provide technical assistance to Public Water Systems (PWS) compromised by flooding Coordinate with PWS owners/operators to develop timelines for restoring service <p>Status:</p> <ul style="list-style-type: none"> Currently, three community PWS, and seven non-community PWS with primary sources of water still off-line Made state revolving loan funds available to affected communities. 	<p>Objectives:</p> <ul style="list-style-type: none"> Work with a livestock waste control facilities (LWCF) and wastewater treatment facilities <p>Status:</p> <ul style="list-style-type: none"> Working with the Platts-mouth WWTF and Crab Orchard's WWTF in their recovery efforts NDEE made state revolving loan funds available to affected communities.
Air	Waste/debris
<p>Objectives:</p> <ul style="list-style-type: none"> Coordinate with local emergency managers/fire departments for individual burn permits <p>Status:</p> <ul style="list-style-type: none"> Burn permits requested/ issued — 8/8 	<p>Objectives:</p> <ul style="list-style-type: none"> Public guidance and outreach for debris management <p>Status:</p> <ul style="list-style-type: none"> Continue providing guidance as floodwater recedes

COUNTY	Drinking Water	Wastewater	Debris Management	Livestock
Boyd	New transmission line installed and placed into service. Water samples to be collected this week to confirm absence of coliform bacteria before lifting boil-water advisory			
Butler				
Cass		Plattsmouth WWTF is re-installing electrical equipment and not yet treating		
Cuming				
Dakota				
Douglas				
Johnson				
Madison				
Nance				
Nemaha				
Otoe				
Pierce				
Platte	NCWSs in Loup River Public Power District and the T-Bone Truck Stop are temporarily inactivated			
Richardson				
Sarpy	NCWSs in Corelab Structures and Falcolnwood Park are temporarily inactivated			
Saunders	The Military Dept. of Nebraska-Camp Ashland is working to repair its system			
Stanton				
Thayer				
Valley				
Washington	Desoto Park Estates NCWS has been temporarily inactivated			