

DEPT. OF ENVIRONMENT AND ENERGY


March 2019 flood dashboard - Week of Sept. 22

NDEE website: dee.ne.gov

NDEE hotline: 1-877-253-2603


Wastewater Facility Status

Community Public Water Systems Status

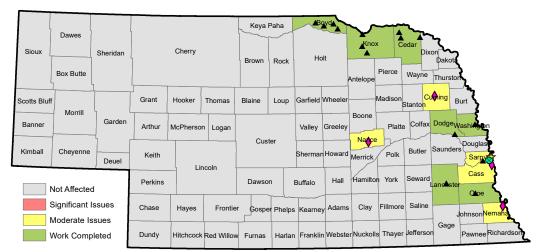

- Repairs to PWS not Complete Unable to provide consistant source of safe drinking water
- Repairs to PWS not Complete Providing consistant source of safe drinking water
- Repairs Complete PWS operating normally
- System Permanently Inactivated

Non-Community Public Water Systems Status

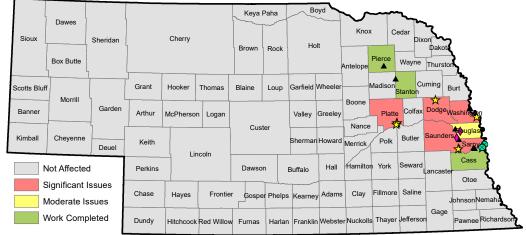

- Repairs to PWS not complete providing consistant source of safe drinking water
- Repairs complete PWS operating normally

Waste Debris Management Status

System Permanently Inactivated

Legend

Box Butte

Not Affected

Significant Issues

Moderate Issues

Work Completed

Deuel




Discharging - No Treatment


· Facility operating normally

Primary Treatment Resumed - No Secondary Treatment



Livestock Facility Status

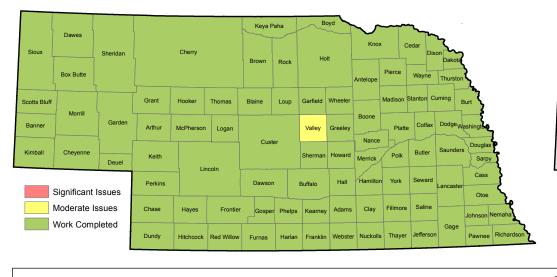

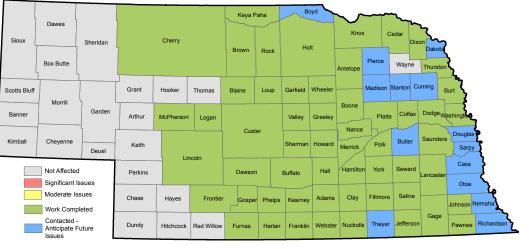

Branches

Drinking/public water Wastewater flooding **Objectives: Objectives:**

 Coordinate with PWS • Provide technical assistance owners/operators to develop to Public Water Systems timelines for restoring service (PWS) compromised by

Status:

• Currently, three community PWS, and seven non-community PWS with primary

sources of water still off-line • Made state revolving loan funds available to affected communities.

Air

Objectives:

• Coordinate with local emergency managers/fire departments for individual burn permits

Status:

• Burn permits requested/ issued -8/8

• Work with a livestock waste control facilities (LWCF) and wastewater treatment facilities

Status:

• Working with the Plattsmouth WWTF and Crab Orchard's WWTF in their

(WWTF) on creating timelines for resuming normal operations.

• Offer/provide financial assistance from the State Revolving Fund (SRF).

recovery efforts

• NDEE made state revolving loan funds available to affected communities.

Objectives:

Waste/debris

• Public guidance and outreach • Continue providing guidfor debris management

Status:

ance as floodwater recedes

Objective:

• Administer weatherization and loan programs

Energy

Status:

• Offered the Dollar and Energy Savings Loan at 1% interest for March flooding. As of Aug. 26: 124 loans committed for

\$427,599.46

systems. As of Aug. 26:

\$2,572,647.28 16 loans entered (not yet committed) for \$35,394.48 35 loans participated for

• Initiated the Weatherization Assistance Program for emergency repairs/replacement for HVAC

Work completed in five homes Work in-progress in two homes

Three pending applications \$17,527.76 in weatherization assistance.

• Offered the DESL at 1% interest for the July flooding in the Central Platte and Republican River Basin areas. As of Aug. 26:

Two loans committed for \$19.842.27 Two loans entered (not yet committed) for \$20,558.87

Zero loans participated at \$0.

Update from

Sept. 15

• Boyd County Rural Water District #2, which also serves the villages of Lynch and Spencer, has lifted its boil water advisory. All water samples from the system were absent for coliform bacteria. The system is now operating normally and has been upgraded to a green designation.